

G61 Tricon Termination Enclosure



The G61 Tricon Termination Enclosure provides termination and marshalling options for Triconex™ Tricon equipment, including DIN rail mounted Triconex termination devices, such as External Termination Panels (ETPs), Field Terminations and External Termination Assemblies (ETAs).

FEATURES

The G61 Tricon termination enclosure offers the following features:

- ▶ Up to seven 1800 mm vertical DIN rails for mounting of termination assemblies and terminal blocks for marshalling, to provide a total of 12.6 m of linear rail space
- ▶ Vented or sealed enclosure selection for use in ordinary (IP 43/55) or harsh (IP 55/66) rated environments
- ▶ EMC compliant version available - vented (IP 43/55) with roof-mounted fans
- ▶ Option for redundant 480W (P0923VD) or 960W 24 V dc field power supplies
- ▶ Main power entry includes disconnect terminal blocks, or 10 A, Type D, double pole circuit breakers.
- ▶ Optional EMC/RFI line filters for redundant main power (Triconex recommended).
- ▶ Alarm contact terminal block assembly for door intrusion monitoring switches, enclosure temperature switch and field power supply status
- ▶ Optional door intrusion monitoring

- ▶ Bottom cable entry for standard power wiring and cables for Triconex termination devices, such as External Termination Panels (ETPs), Field Terminations and External Termination Assemblies (ETAs)

NOTE

Due to the placement of field power supplies, top entry is not recommended for this enclosure.

- ▶ Available PVC or non-PVC wireways for field I/O cabling, with optional signal segregation barrier plate
- ▶ Generous 76 mm x 102 mm (3 in x 4 in) wire ducts with adequate capacity for most wire management
- ▶ Compact design to minimize use of floor space with both front and rear access that allow maximum packaging density of control environment
- ▶ Conveniently placed eyebolts for transporting and lifting the enclosures
- ▶ A 100 mm (4 in) plinth increases total enclosure height of 2160 mm (85.0 in)
- ▶ Comfort handles with push-button/keylocks
- ▶ Two earth (ground) points; two protective earth (ground) studs, and one isolated protective earth (ground) rail.

INTRODUCTION

The G61 Tricon termination enclosure is specifically designed for housing Triconex termination devices and additional customer-supplied terminal blocks for marshalling. This enclosure may accommodate the termination of Tricon modules which are housed in a G60 Tricon System Enclosure or G62/G72 Tricon System and Termination Enclosure.

The G61 enclosure is available as a vented or sealed enclosure. It can be configured with:

- ▶ Up to seven vertical DIN rails for mounting of Triconex termination devices and additional customer-supplied terminal blocks for marshalling.
- ▶ Redundant power supplies (480W or 960W 24 V dc power supplies) for field power.

The G61 vented enclosure is a free-standing, floor mounted unit with an IP 43/55 rating for location in mild (ordinary) environmental areas.

The G61 sealed enclosure is a free-standing, floor mounted unit, with options for either an IP 55 or IP 66 rating for location in harsh environments. Sealed enclosures with an IP 66 rating provide a higher level of protection from airborne contamination.

NOTE

In regions that require EMC compliance, you must order the EMC compliance option if the Triconex termination devices for Tricon modules SMM or SRXM will be installed in this enclosure. Without these termination devices, the enclosure already fulfills the requirements for EMC compliance.

An optional door intrusion monitoring switch is available for each door on this enclosure. Each switch is prewired to a set of alarm status terminal blocks.

The G61 enclosure can be installed bayed or adjoined to other Triconex enclosures to maximize the use of floor space and ease of cabling. The enclosures can be bayed together using third-party kits.

This enclosure and its configurations have been tested and qualified by Invensys for use with the Tricon equipment.

INGRESS PROTECTION

The metal enclosures provide the outer layer of protection for the control electronics. Other layers are provided by the module covers and built into the modules. This approach to protection means that a minimum of contaminants in the plant environment reaches the control components, thus greatly extending the life of the equipment.

For sealed, non-adjoined G61 enclosures, heat is transferred from the interior surfaces of the enclosure and then dissipated by the enclosure's exterior surfaces into the plant environment. Air is not exchanged between the enclosure's interior and the outside environment; therefore, contaminants are minimized inside the enclosure.

The enclosures support convenient top or bottom cable entry for termination assembly cabling and power wiring. Vented enclosures with roof-mounted fans are not recommended with top cable entry, due to the location of the power supplies.

DUAL THERMOSTAT

An optional dual (high/low) thermostat is available to monitor enclosure temperature extremes.

DOOR INTRUSION MONITORING

An optional door intrusion monitoring switch is available for each door on the enclosure. Each switch is prewired to a set of alarm status terminal blocks.

VENTED ENCLOSURE DESIGN OPTIONS

The G61 vented enclosure is available with either roof-mounted or door-mounted fans.

Roof-mounted fans provide the best performance for cooling, and provide a lower noise-level than the door-mounted fans, at the cost of restricting top-entry cable access to the enclosure and reducing the overall ingress protection rating.

For customers who plan to modify the swing direction of their enclosure doors, fans mounted on the roof allow the process to proceed more smoothly.

Door-mounted fans are desirable for top entry cable access configurations, and provide the highest level of ingress protection for vented enclosures.

TRICONEX TERMINATION DEVICE MOUNTING

The G61 termination enclosure has up to seven vertical DIN rails for mounting the appropriate Triconex termination devices, and one dedicated vertical DIN rail for power distribution. Four of the DIN rails are accessible from the rear of the enclosure and four of the DIN rails are accessible from the front of the enclosure. For each set of four DIN rails, two are mounted in the center of the enclosure, and two are mounted on the sides.

Optional bus bars for field wiring shields and DIN rail isolation are available. These are used when customer field shields are terminated on dedicated terminal blocks that ground to the DIN rail. Isolation allows rails to be isolated from the enclosure earth.

One or two pairs of optional redundant 24 V dc field power supplies are available for field power. They are mounted horizontally in the enclosure (see Figure 2 through Figure 5).

Both vented and sealed enclosures have a limited thermal load (see "Operating Temperatures" on page 12).

TRICONEX TERMINATION DEVICE/INPUT POWER CABLING

The G61 enclosure can be ordered for bottom cable entry or modified by the customer for simultaneous top and bottom cable entry.

For the top cable entry version, the termination device cables and/or customer power feeds enter through customer-configured cable glands. Any customizations made must follow the manufacturer's guidelines to preserve the enclosure's ingress protection rating. Vented enclosures with roof and door-mounted fans are not recommended for top cable entry.

For the vented bottom entry version, the termination device cables and power cable enter through removable gland plates, located at the bottom (inside) of the enclosure, which can be removed, drilled, or punched for cable routing.

For the sealed bottom entry version, the termination device cables and power cable enter through a solid bottom panel located at the bottom (inside) of the enclosure, which can be drilled, or punched for cable routing. Users must provide their own cable glands (for top or bottom cable entry), in keeping with maintenance of the enclosure's ingress protection. It is the user's responsibility to ensure that the enclosure's environmental ratings are retained.

An optional signal segregation barrier plate provides isolation between any two interior adjacent wireways.

Cabling is restricted to preconfigured wireways, available in PVC or non-PVC versions.

Cable straps are provided in the enclosure to dress and support the Triconex termination cables.

POWER AND EARTHING (GROUNDING)

The G61 enclosure supports an optional redundant power system for field power to protect against power failures.

Field power wiring to the enclosure is routed through the bottom of the enclosure. Customer-supplied dual power input feeds terminate at dedicated redundant power distribution terminal block or circuit breaker assembly.

All enclosure structural elements are integrally earthed by the enclosure design to meet the appropriate industry regulations and standards.

Earthing (Grounding)

Two M8 studs (one for each enclosure side) provide a central earth (ground) point and dedicated earthing points when baying enclosures together.

An isolated protective earth (ground) rail is available for additional earth (ground) points and may be used for cable shields.

Power Distribution

Each enclosure is available with a dedicated assembly for customer field power. Two types of power distribution are available with:


- ▶ Disconnect terminal blocks. This method of power entry also has fused, knife disconnect terminal blocks for isolating the field power, as well as independent knife disconnect terminal blocks for each device, for ease of service.
- ▶ 10 A, Type D, double pole circuit breakers.

The 24 V dc field power supply option also includes a distribution terminal block assembly for distribution of 24 V dc power to up to ten Triconex termination devices. Each point includes a serviceable knife disconnect.


Utility power is supported through a dedicated terminal block or circuit breaker assembly which provides independent disconnects for light and fan circuits as well as additional blocks for the customer to install utility outlets.

The enclosure may be ordered without these power distribution terminal blocks when the customer has requirements for power distribution specific to regional electrical codes.

G61 Termination Layout and DIN Rail Identification

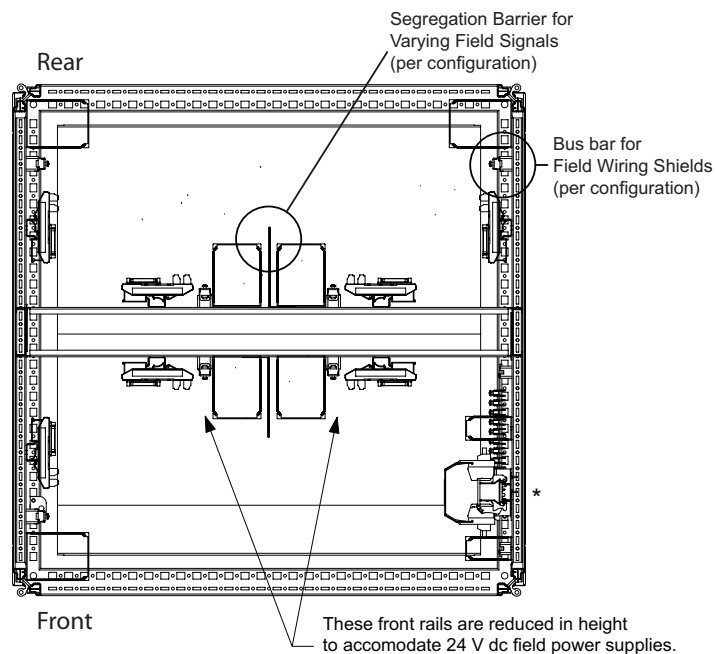


G61 Marshalling Layout and DIN Rail Identification

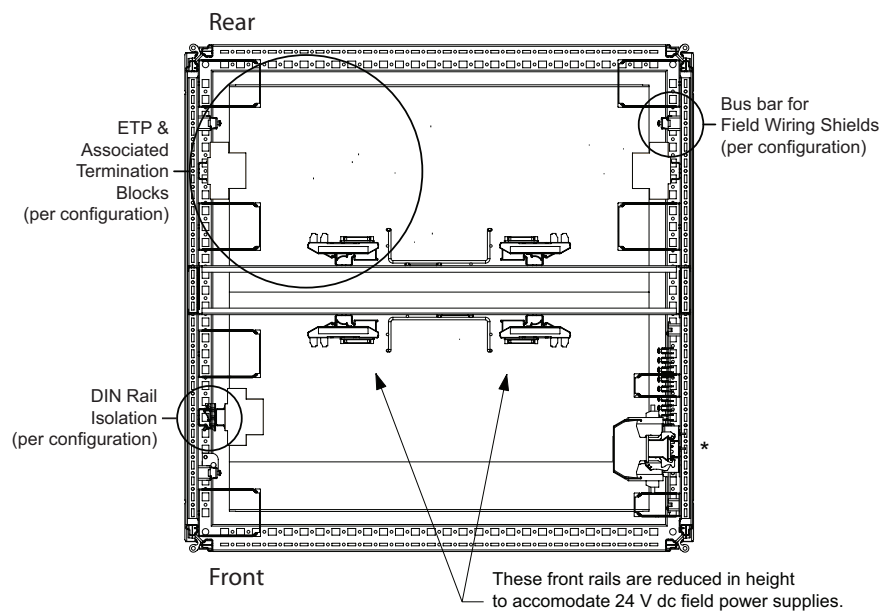


*For both setups, this front side rail is reserved for field and utility power entry terminal blocks/circuit breakers, alarm status terminal blocks and EMI line filters per configuration.

Figure 1. G61 Tricon Termination Enclosure Termination and Marshalling Layouts and DIN Rail Identification

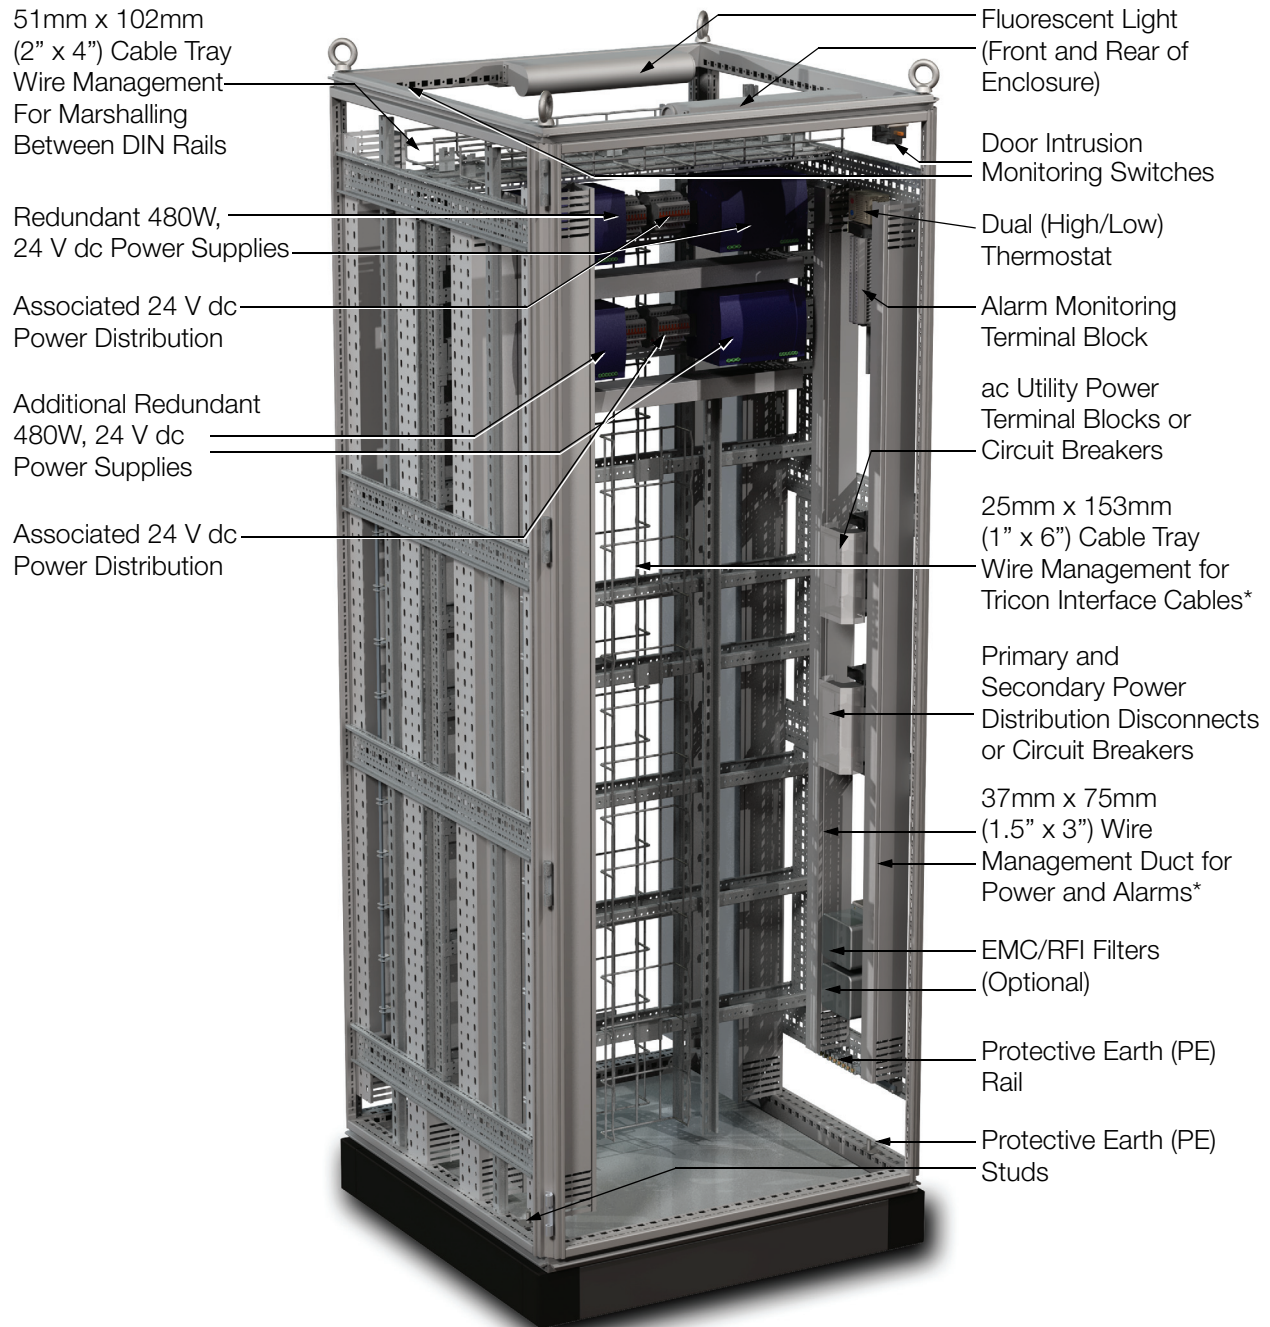


* Some cable trays and wire management ducts may not be supplied with the standard configuration.

Figure 2. G61 Tricon Termination Enclosure with Marshalling Option, Front View, Bottom Entry

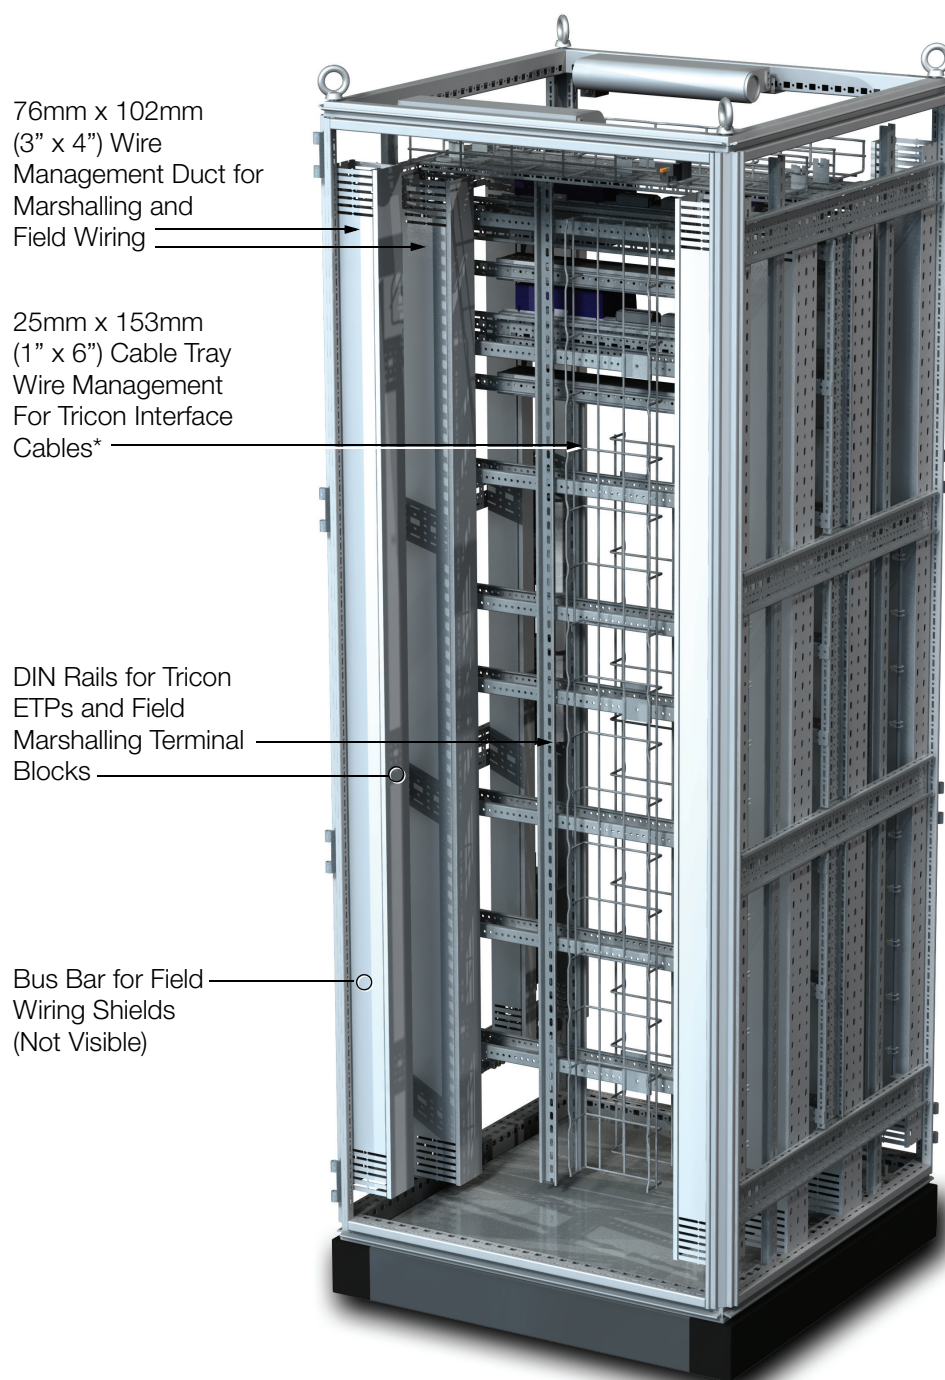


* Some cable trays and wire management ducts may not be supplied with the standard configuration.

Figure 3. G61 Tricon Termination Enclosure with Marshalling Option, Rear View, Bottom Entry

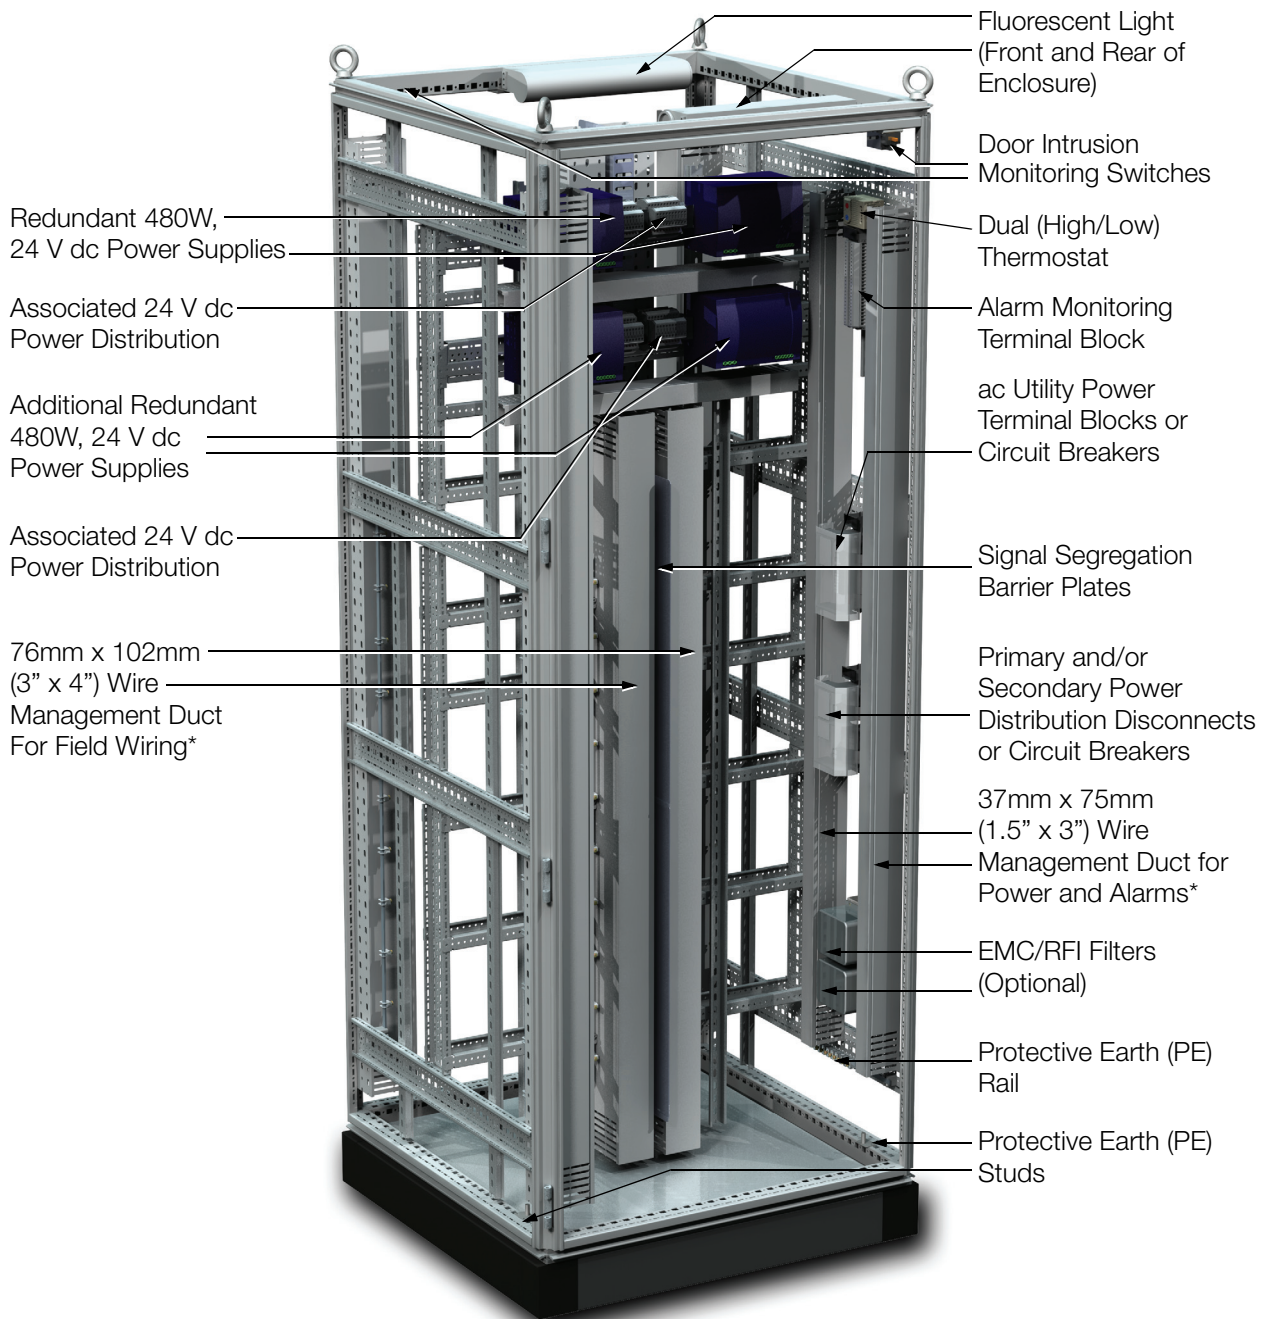

* Some cable trays and wire management ducts may not be supplied with the standard configuration.

Figure 4. G61 Tricon Termination Enclosure with Termination Option, Front View, Bottom Entry

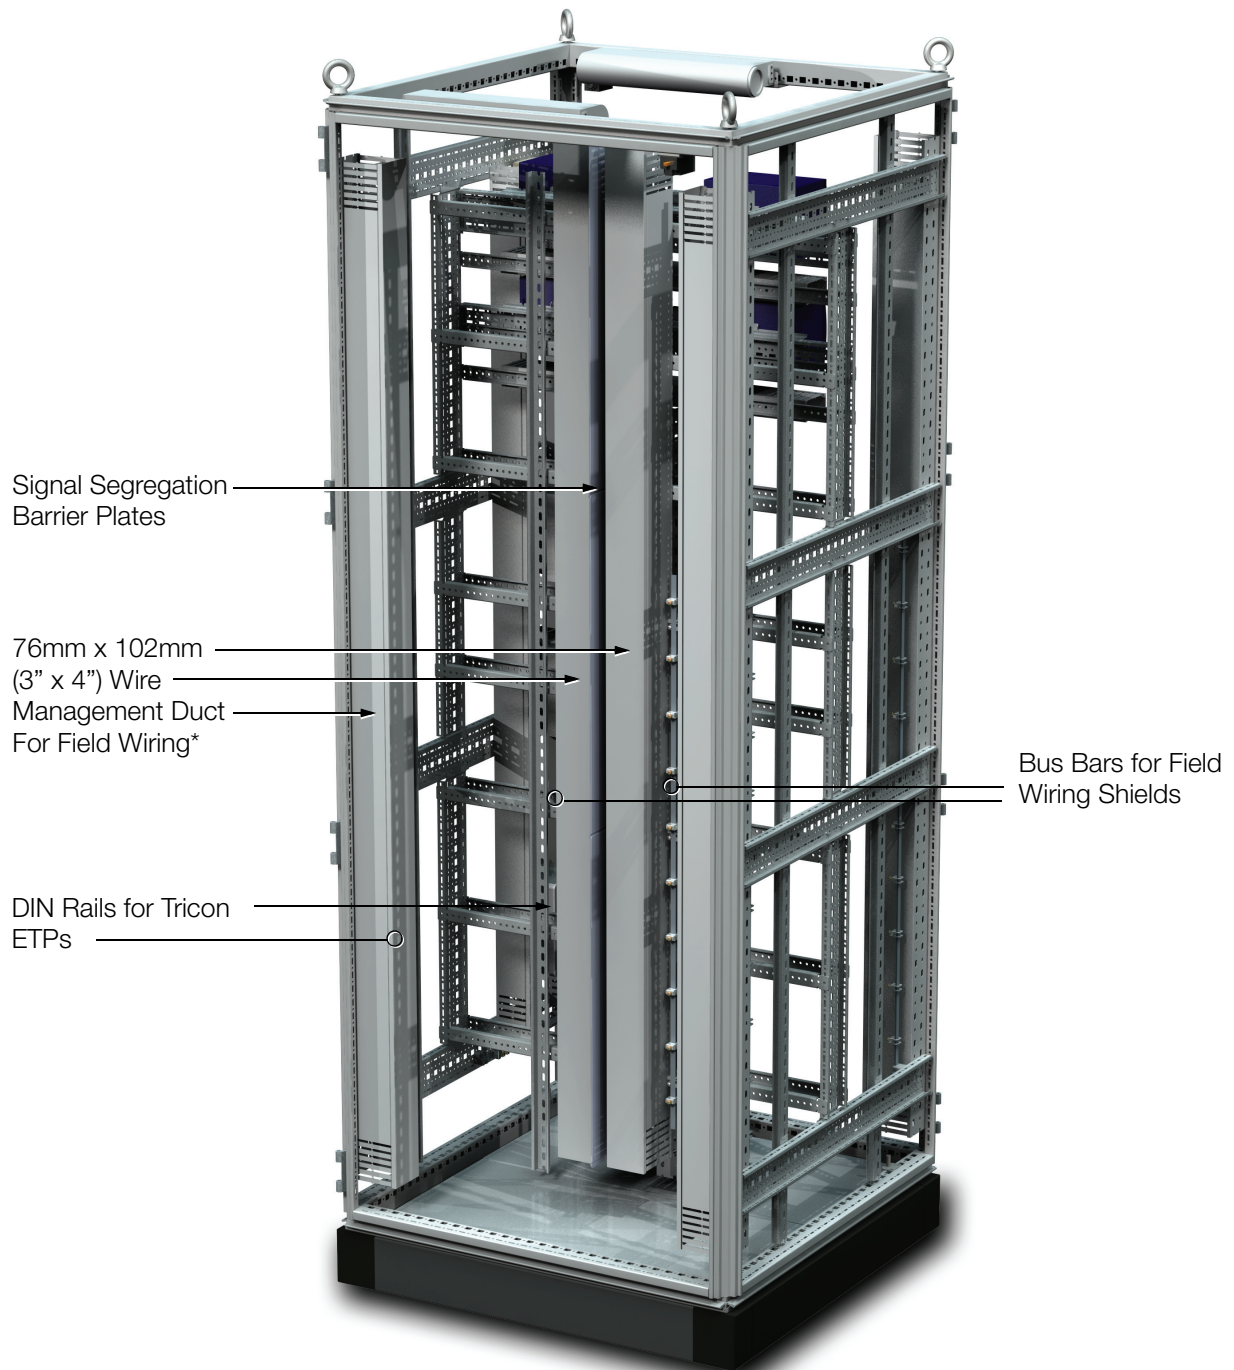

* Some cable trays and wire management ducts may not be supplied with the standard configuration.

Figure 5. G61 Tricon Termination Enclosure with Termination Option, Rear View, Bottom Entry

ENCLOSURE OPTIONS

The G61 enclosure can be configured with the following options:

Table 1. G61 Enclosure Features and Options

Feature	Availability
Base Enclosure	Vented IP 43 rated enclosure with front and rear door-mounted fans (120 V ac or 240 V ac - dual fans) or roof-mounted fans (120 V ac or 240 V ac - dual fans) -OR- EMC compliant vented IP 43 rated enclosure with roof-mounted fans (120 V ac or 240 V ac - dual fans) -OR- Sealed IP 55/66 rated enclosure (no fans)
Enclosure Access	Front and rear access
Front Door	Solid front door - vented enclosure has inlet vents
Cable Entry	Bottom (Due to the placement of field power supplies, top entry is not recommended for this enclosure.)
Sidewalls	Options configurable based on baying requirements
Door Handle	Comfort handle with push-button/keylock
Door Mounting	Universal mounting for left and right-hand door swing (left-hand is default)
Field Wiring	PVC -OR- non-PVC wireways for field I/O signal cabling Optional bus bars for field wiring shields and/or DIN rail isolation.
Equipment Supported	Seven DIN rails per enclosure available for mounting Triconex termination devices only, or with customer-supplied terminal blocks for marshalling. One DIN rail dedicated for power distribution equipment
Enclosure Lighting	Universal enclosure lights (front and rear) with motion activation
Thermostat	Dual temperature thermostat
Security	Optional door intrusion monitoring switch - one per door
Fans	Door-mounted or roof-mounted fans - designed for secondary cooling only.
Earthing (Grounding)	Two protective earth (ground) studs One isolated protective earth (ground) rail

Table 1. G61 Enclosure Features and Options (Continued)

Feature	Availability
Field Power	Optional redundant 24 V dc field power - 480W or 960W (two or four field I/O power supplies) with dedicated distribution terminal block or circuit breaker assemblies Redundant power distribution terminal block assemblies for customer configured power entry. Optional EMC compliant line filters available for above options. Additionally, customer-configured field power entry is supported (no terminal blocks supplied).
Alarm Contact	Alarm contact terminal block assembly for main chassis alarming, door intrusion monitoring switches, enclosure temperature switch and field power supply status.
Utility Power	120 V ac or 240 V ac utility power with disconnect terminal blocks or 10 A, Type D, double pole circuit breakers

FUNCTIONAL SPECIFICATIONS

Enclosure

The enclosures are free-standing, floor mounted, steel industrial enclosures containing:

- ▶ Vertically mounted DIN rail mounted termination equipment (Triconex Tricon and/or customer-supplied terminal blocks for marshalling)
- ▶ 24 V dc field power supplies (single or redundant power).

ENVIRONMENTAL SPECIFICATIONS

Ingress Protection Ratings

VENTED

Door-Mounted Fans

IP 55 to EN 60 529 / NEMA 12

Roof-Mounted Fans

IP 43 to EN 60 529/10.9191 / NEMA 12

SEALED

IP 55 to EN 60 529 / NEMA 12

IP 66 to EN 60 529 / NEMA 4

Operating Temperatures

Thermal performance of the G61 enclosure meets the convection cooling requirements described in the *Planning and Installation Guide for Tricon Systems*⁽¹⁾.

VENTED (THERMAL LOADING)⁽²⁾

- 20 to +60°C (-4 to +140°F)
- Up to 750 Watts (Average)
- 20 to +55°C (-4 to +131°F)
- 750 to 1000 Watts (Maximum)

SEALED (THERMAL LOADING)⁽²⁾

- 20 to +50°C (-4 to +122°F)
- Up to 400 Watts (Average)
- 20 to +45°C (-4 to +113°F)
- 400 to 500 Watts (Maximum)

Storage Temperature

-40 to 70°C (40 to 158°F)

Relative Humidity

5 to 95% (noncondensing)

Acoustic Noise Level⁽³⁾

ROOF-MOUNTED FANS

61 dB (A) at 1 m / 58 dB (A) at 3 m

DOOR-MOUNTED FANS

64 dB (A) at 1 m / 62 dB (A) at 3 m

SEALED ENCLOSURE (NO FANS)

Ambient / Ambient

Dual Thermostat

HIGH ALARM SETTING

NC contact, Range - 0 to 60°C (32 to 140°F)

LOW ALARM SETTING

NO contact, Range - 0 to 60°C (32 to 140°F)

Agency Certification

Empty enclosure is UL and UL-C approved. Enclosure meets all applicable European Union directives and is CE compliant. Final installed enclosures populated with your equipment should be inspected by your local UL/CSA committee, or other local safety governing organization if required. A complete listing of certifications is available from enclosure vendor.

Area Designation

General purpose areas.

(1) To obtain the latest version of the *Planning and Installation Guide for Tricon Systems* document, contact IPS Global Client Support.

(2) Some termination assemblies have operating temperatures lower than the rated enclosure specification.

(3) Under normal operating conditions, with both fans running, at enclosure's mid-height at 46 dB (A) ambient noise level.

PHYSICAL SPECIFICATIONS

Mass

The mass of the enclosure is dependent upon the particular configuration. Consult with an Invensys representative if precise mass figures are required.

VENTED ENCLOSURE (MAX. CONFIGURATION)

800 mm x 800 mm - 261 kg (575 lb)

SIDE PANEL

800 mm x 800 mm - 8 kg (18 lb)

Mounting

Floor

CAUTION

To prevent injury, this enclosure must be bolted down. Refer to the installation guide.

Construction

MATERIAL

Doors (Metal)

Sheet steel, 2.0 mm (14 ga)

Frame, Roof, Side Panels, Gland Plates

Sheet steel, 1.5 mm (16 ga)

Base/Plinth

Sheet steel and plastic

FINISH

Frame

Non-EMC Compliant Version

Dipcoat-primed, RAL 7044 smooth

EMC Compliant Version

Aluminum Zinc coating

Roof, Side Panels, Doors

Non-EMC Compliant Version

Dipcoat-primed, powder-coated, RAL 7035 (light gray) textured

EMC Compliant Version

Exterior - Dipcoat-primed, powder-coated, RAL 7035 (light gray) textured

Interior - Aluminum Zinc coating

Base/Plinth

Dipcoat-primed, RAL 7022 (umbra gray) smooth, plastic cover caps RAL 9005 (jet black)

Gland Plates and Internal Hardware

Zinc-plated, passivated

Cable Entry

VENTED ENCLOSURE

Bottom through gland plate(s)

Top through customer cutouts in enclosure top (For enclosure with roof-mounted fans, suggested entry is bottom)

SEALED ENCLOSURE

Bottom through steel panel and customer cutouts in panel

Top through customer cutouts in enclosure top

Earthing (Grounding)

ROOF, SIDEWALLS, GLAND PLATES

Automatic potential equalization built in

FRONT AND REAR DOORS

Dedicated 4 mm² (11 ga) ground strap to enclosure frame

ENCLOSURE

Two protective earth (ground) M8 studs (one for each enclosure side)

An isolated protective earth (ground) rail is provided for an additional earth (ground) point.

Power Input Terminals

DISCONNECT TERMINAL BLOCKS

Type

Ring Lug

Wire Size

Up to 6 mm² (10 AWG)

Ring Lug Size

M4 Maximum (DIN 46 234/46 237), 9.6 mm maximum O.D.

CIRCUIT BREAKERS

Type

Compression

Wire Size

Solid: Up to 6 mm² (3 AWG)

Stranded: Up to 4 mm² (8 AWG)

Termination Assembly Cabling

Universal mounting straps are supplied for securing, routing and strain relieving of Triconex termination cables. Each strap supports up to a 75 mm (3 in) diameter cable bundle.

FOR MORE INFORMATION


For additional information describing Tricon enclosures for Triconex termination devices, such as External Termination Panels (ETPs), Field Terminations and External Termination Assemblies (ETAs), refer to the following documentation:

Document Number	Document Title
PSS 21H-2X60 B4	G60 Tricon System Enclosure
PSS 21H-2X62 B4	G62 and G72 Tricon System and Termination Enclosures
PSS 21H-2X66 B4	G66 Tricon Termination Enclosure
ISA-S71.04-1985 (not Invensys-supplied)	Environmental Conditions for Process Measurement and Control Systems: Airborne Contaminants
9791007-XXX ^(a)	Technical Product Guide for Tricon Systems
9720052-XXX ^(a)	Field Termination Guide for Tricon Systems

(a) Request latest revision from Triconex.

DIMENSIONS - NOMINAL

G61 Tricon Termination Enclosure Front and Rear Access

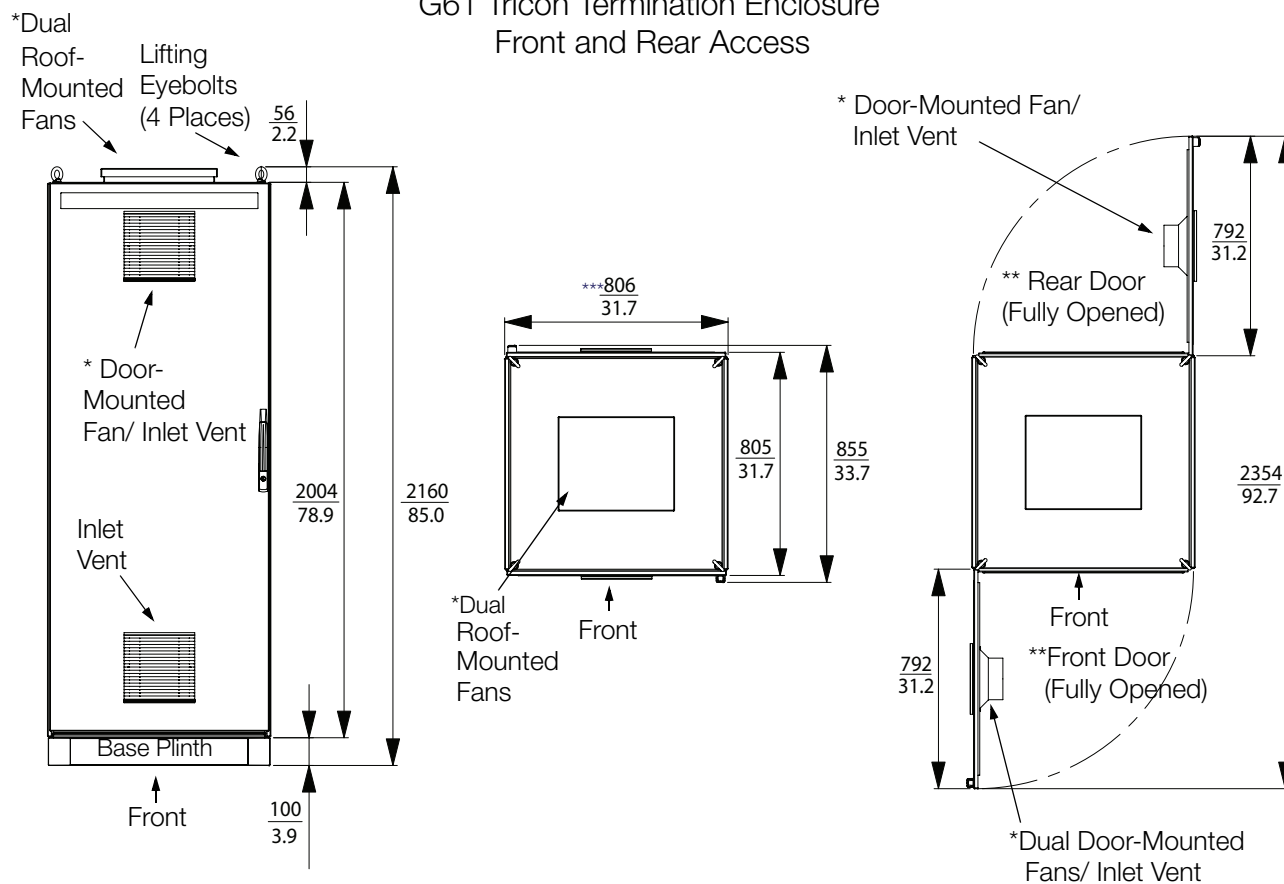

* VENTED ENCLOSURES ONLY - EITHER ROOF- OR DOOR-MOUNTED CONFIGURATIONS CAN BE ORDERED.

** DOORS ARE FACTORY-CONFIGURED FOR LEFT-HAND SWING, BUT CAN BE RECONFIGURED AT SITE FOR RIGHT-HAND SWING.

***WITH SIDE PANELS, WITHOUT SIDE PANELS 800/31.5

Invensys Operations Management
5601 Granite Parkway Suite 1000
Plano, TX 75024
United States of America
<http://iom.invensys.com>

Global Customer Support
Inside U.S.: 1-866-746-6477
Outside U.S.: 1-508-549-2424 or contact
your local Invensys representative.
Email: support@invensys.com
Website: <http://support.ips.invensys.com>

Invensys, Foxboro, I/A Series, and the Invensys logo are trademarks of Invensys plc, its subsidiaries, and affiliates. All other brands and product names may be the trademarks of their respective owners.

Copyright 2009-2010 Invensys Systems, Inc. All rights reserved. Unauthorized duplication or distribution is strictly prohibited.