

# Foxboro Evo™ Process Automation System


## Product Specifications

# Foxboro®

by Schneider Electric

PSS 31H-8C8

### Foxboro Evo™ Remote Terminal Unit (RTU) 3 Phase Digital Transducer Module

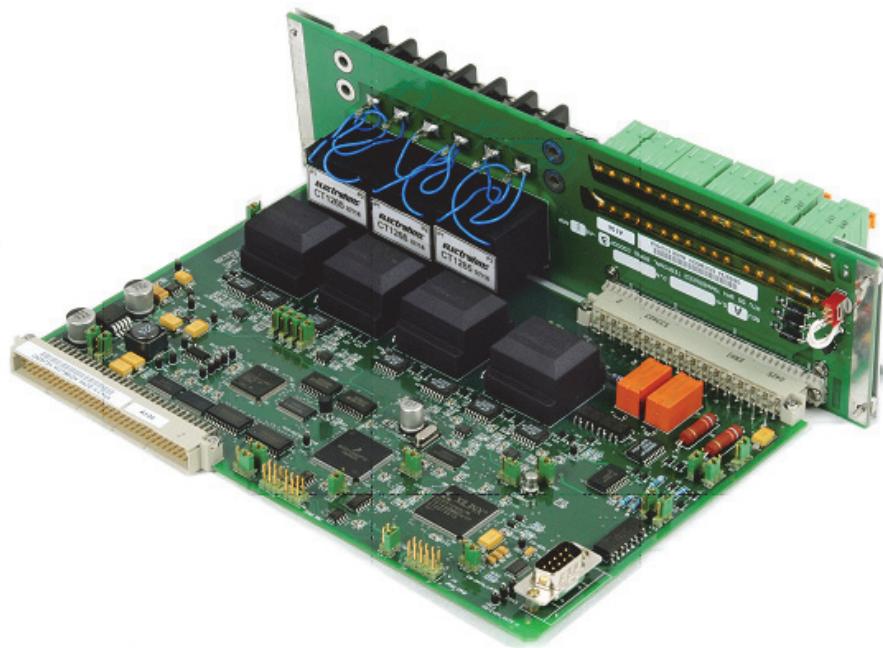

#### OVERVIEW

The 3 Phase Digital Transducer Module provides a direct interface to voltage and current transformers, replacing the need for external transducers.

The onboard digital signal controller uses voltage and current inputs to the module to calculate the electrical quantities of frequency, volts, amps, phase angle, sine of current phase angle, watts, power factor, VARs, VA, and positive, negative and zero phase sequence voltages.

#### FEATURES

- ▶ Simultaneous sampling eliminates skew error
- ▶ Replaces MW, MVAR, MVA, volts, amps, frequency, and power factor transducers for single and three phase circuits
- ▶ Availability of volts, frequency, and phase angle

for a fourth voltage input


- ▶ Provides two digital inputs and outputs for use as additional I/O
- ▶ 0.5% accuracy
- ▶ Operates at 40 MHz
- ▶ Current Transformers (CTs) mounted on the termination board can be disconnected without breaking the CT circuit
- ▶ Current and voltage transformers (VTs) can be connected in either a Star or Delta configuration
- ▶ Current transformers have dual windings to protect against open circuits
- ▶ Dual sync-check functions permit the RTU to automate circuit breaker closure synchronization interlocking and control

## MODULE DESCRIPTION

The main board contains the Digital Signal Controller (DSC), which has on chip RAM, Flash, EEPROM, and four 4-channel 12-bit Analog/Digital Converters (ADC). This board also has Amplifiers and Anti-Aliasing Filters.

VTs are mounted on this board. The interface to Electrobus is by a dual port memory (DPRAM) on the main board. CTs are mounted on the terminal board to prevent the CT current loop from disconnecting.

Two 4-channel ADCs are used to simultaneously sample eight channels. This simultaneous sampling eliminates any skew error. Seven channels are used to provide the isolated transformer signals. The eighth channel is used to monitor temperature and allow dynamic temperature conversion. The temperature sensor is available on the DSC chip. Refer to Figure 1.

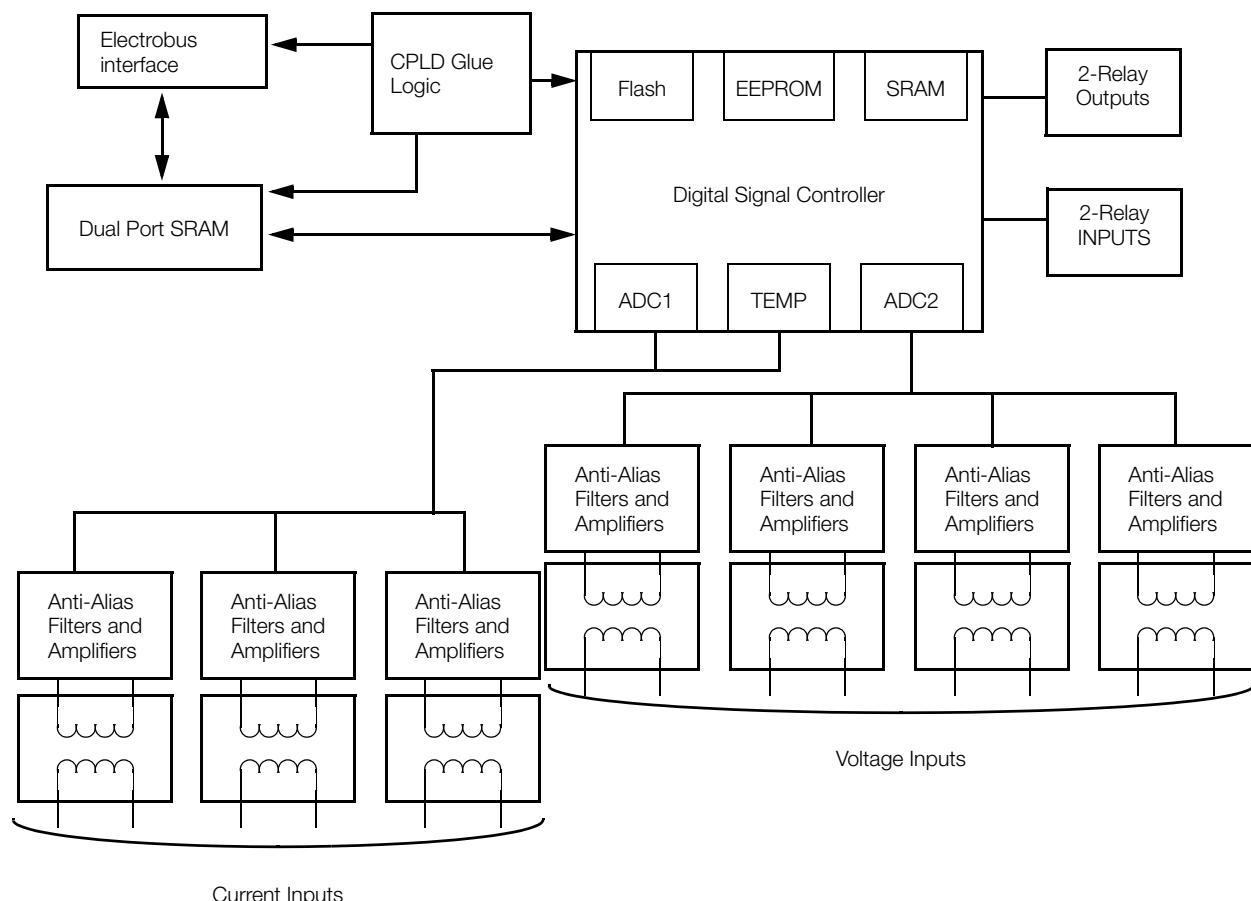

*Figure 1. 3 Phase Digital Module Functional Block Diagram*

## Front Panel Inputs

Four voltage inputs are provided as shown in Figure 2. These are connected to voltage field transformers. Three of the inputs are normally used to measure the voltage upstream of a circuit breaker. The fourth input is used to measure the voltage downstream of the breaker and to synchronize the check application.

Three 2-terminal current inputs are provided, which are connected to current field transformers. These inputs are available in either 1 or 5 A nominal signal configurations.

In addition, a utility digital input and output are provided, which follow the specifications of the RTU50 Analog/Digital Input Module.

## Front Panel Outputs

Also provided are two digital outputs that meet the specifications of the RTU50 Pilot Relay outputs.

These outputs, along with the digital inputs explained in the previous section, are used to provide additional general purpose I/O.

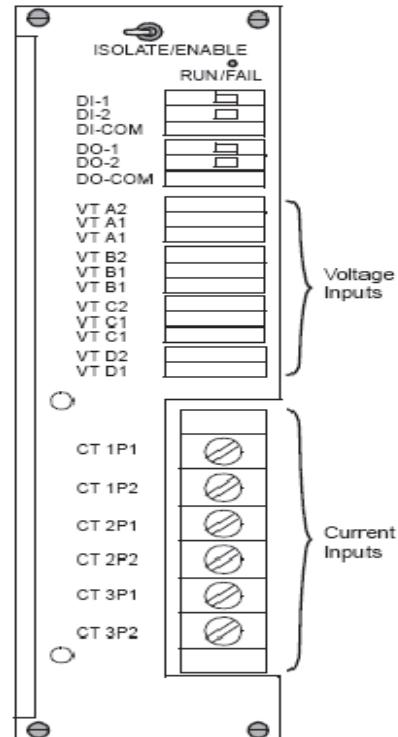


Figure 2. Front Panel

## PHYSICAL SPECIFICATIONS

### Power Supply

Electrobus Interface

### Physical Size

262 mm x 196 mm x 71 mm

### Processor Type

MC56F8346 - 40 MHz (100 nS cycle) DRAM  
16 KB x 16 Cypress CY7C026 (25 nS)

### INTERNAL FLASH

64 KB x 16

### INTERNAL EEPROM

8 KB x 16

### ADC

Internal 4 x 4 ch (2 ch. simultaneous)  
+3V input range, unipolar  
±2 ppm/oC reference error  
±1 count relative capacity

## ENVIRONMENTAL SPECIFICATIONS

### Operating Temperature

#### STANDARD

0°C to 60°C (32°F to 140°F)

### Humidity

10 to 95% RH (noncondensing)

## FUNCTIONAL SPECIFICATIONS

### Limits of Nominal Range

**VOLTS**

Nominal 63.5 V or 110 V user configurable

**AMPS**

Current ranges of 1 or 5 A dictated by the part number ordered

**FREQUENCY**

30-110% (50 Hz and 60 Hz)

### Overload Capacity

#### TWO HOUR CONTINUOUS OVERLOAD

*Current Inputs*

125% of nominal

*Voltage Inputs*

125% of nominal

#### SHORT DURATION

*Current Inputs*

20 times rated current for 2 seconds

*Voltage Inputs*

2 times rated voltage for 2 seconds

*Isolation*

2 kV rms

### Transient Protection

Meets IEC 255-4 (1976) Class 3;  
 IEEE C37.90.1-1974; IEC 255-22-4; IEC 801-4;  
 AS 2481-1981

**Anti-Aliasing Filter**

7 x switched capacitor type

**Temperature Reference**

Onboard, Class 2 accuracy

**Bandwidth**

250 Hz

**CPU Update Time**

All quantities every cycle; the CPU performs calculations every power station cycle; CPU updates are performed every 100 msec

**Accuracy**

0.5% of full scale output at reference conditions, as per AS1384-1973 over the following ranges

**VOLTS**

80% to 110%

**AMPS**

20% to 125%

**FREQUENCY**

95% to 105%

**Burden of Measuring Circuit**

Not to exceed:

0.1 VA per element for voltage circuit

0.1 VA per element for current circuit

## ORDERING INFORMATION

Part Number	Description
SY-0399140	3 Phase Digital Transducer Module (1 Amp, 0.5% Accuracy)
SY-0399142	3 Phase Digital Transducer Module (5 Amps, 0.5% Accuracy)
SY-1014601	Serial null modem cable for field upgrades of firmware

# Foxboro®

by Schneider Electric

Invensys Systems, Inc  
 10900 Equity Drive  
 Houston, TX 77041  
 United States of America  
<http://www.invensys.com>

Global Customer Support  
 Inside U.S.: 1-866-746-6477  
 Outside U.S.: 1-508-549-2424  
[Website: https://support.ips.invensys.com](https://support.ips.invensys.com)

Copyright 2015 Invensys Systems, Inc.  
 All rights reserved.  
 Invensys is now part of Schneider Electric.

Schneider Electric, Invensys, Foxboro, and Foxboro Evo are trademarks owned by Schneider Electric SE, its subsidiaries and affiliates.

All other trademarks are the property of their respective owners.

MB 031

0315