


Analog Input (AIN) Block

PSS 41S-3AIN

Product Specification

April 2019

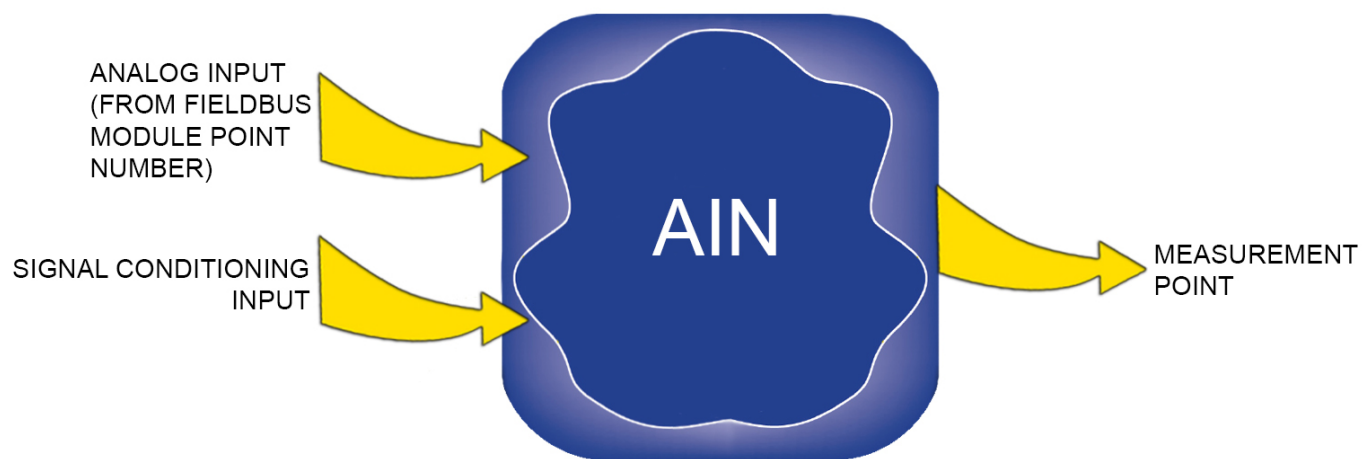

Legal Information

Schneider Electric, EcoStruxure, Foxboro, I/A Series, and Triconex are trademarks and the property of Schneider Electric SE, its subsidiaries and affiliated companies. All other trademarks are the property of their respective owners.

This guide and its content are protected under applicable copyright laws and furnished for informational use only. No part of this guide may be reproduced or transmitted in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), for any purpose, without the prior written permission of Schneider Electric. Schneider Electric does not grant any right or license for commercial use of the guide or its content, except for a nonexclusive and personal license to consult it on an "as is" basis.

Schneider Electric products and equipment should be installed, operated, serviced, and maintained only by qualified personnel.

As standards, specifications, and designs change from time to time, information contained in this guide may be subject to change without notice.

To the extent permitted by applicable law, no responsibility or liability is assumed by Schneider Electric and its subsidiaries for any errors or omissions in the informational content of this material or consequences arising out of or resulting from the use of the information contained herein.

Overview

The Analog Input (AIN) block is a single channel (point) signal conditioning block for scanning, filtering and alarm implementation of a field measurement.

Manual/Auto control of the measurement point output allows the user to disconnect a control scheme from a live process input, for simulation and checkout purposes.

The AIN block provides alarming upon detection of a fault in the operational status of the Fieldbus Module or input channel, and high/low absolute alarming of the conditioned measurement output.

The delayed alarming feature reduces the number of nuisance alarms as a block parameter crosses over an alarm limit multiple times in a short period.

Standard Features

- Selectable signal conditioning of the analog input signal.
- Manual/Auto control of the measurement output signal, which can be initiated by a host process or another block.
- Bad-input-point detection. The AIN block detects errors in the operational status of the Fieldbus Module or input channel, and provides a bad-point indicator for optional alarming.
- Clamping of the measurement output signal when it exceeds a specifiable range.

Extended Features

- Last good value retention. When a bad-input point is detected, the AIN block retains, on option, the last good value for the measurement output. When all detected errors are corrected, the block resumes normal operation.
- First- or second-order filtering. Filtering introduces a lag dependent on a specifiable time constant. Filtering also minimizes changes to an output signal that may be stimulating actual process changes.
- External or internal temperature reference for thermocouple cold-junction compensation.
- Bad input point alarming. The outputs include an alarm indicator signal and a user-defined alarm message.
- High and low absolute alarming of the measurement output signal. The outputs include alarm indicator signals and user-defined alarm messages.
- Inhibiting of block alarm messages.
- Indication of the alarm level (1 to 5) and alarm type of the highest-priority active alarm for the block.
- Conditioning of a low frequency pulse input from a digital input (16 DI only) Fieldbus Module.
- Meter factor for converting an input pulse rate to the desired engineering units.
- Scale and bias terms for converting thermocouple and resistance thermometer outputs from degrees Celsius to another temperature scale.

Principal Parameters

Inputs

- One analog input point
- Signal conditioning index (integer)
- Manual/Auto control mode switching (Boolean)

Outputs


- Conditioned measurement point output (real)
- Three alarm indicators (Boolean)

Additional Features

- Delayed alarming. A configurable timer delays alarm detection or return-to-normal messages for a specific alarm to reduce the number of alarm messages generated when a block parameter crosses back and forth over an alarm limit.
- Quality Status output parameter provides a single source for the block's value record status, block status, and alarm status.

Signal Conditioning Index Assignments

Conditioning Index	Signal Conditioning
0	No Conditioning
1	0 to 64 000 raw counts linear (0 to 20 mA)
2	1600 to 64 000 raw counts linear (nominal 0 to 10 V dc)
3	12 800 to 64 000 raw counts linear (4 to 20 mA)
4	0 to 64 000 raw counts square root (0 to 20 mA)
5	12 800 to 64 000 raw counts square root (4 to 20 mA)
6	0 to 64 000 raw counts square root with low cutoff (3/4%) (0 to 20 mA)
7	12 800 to 64 000 raw counts square root with low cutoff (3/4%)(4 to 20 mA)
8	pulse rate
10	Intelligent Transmitter support
20	type B thermocouple
21	type E thermocouple
23	type J thermocouple
24	type K thermocouple
25	type N thermocouple
26	type R thermocouple
27	type S thermocouple
28	type T thermocouple
40	copper RTD
41	nickel RTD
42	platinum RTD (DIN)
43	platinum RTD (IEC)
44	platinum RTD (SAMA)

 **WARNING:** This product can expose you to chemicals including lead and lead compounds, which are known to the State of California to cause cancer and birth defects or other reproductive harm. For more information, go to www.p65warnings.ca.gov/.

Schneider Electric Systems USA, Inc.
38 Neponset Avenue
Foxborough, Massachusetts 02035–2037
United States of America

Global Customer Support: <https://pasupport.schneider-electric.com>

As standards, specifications, and design change from time to time, please ask for confirmation of the information given in this publication.

© 2014–2019 Schneider Electric. All rights reserved.

PSS 41S-3AIN, Rev A