


Motor Operated Valve (MOVLV) Block

PSS 41S-3MOVLV

Product Specification

May 2019

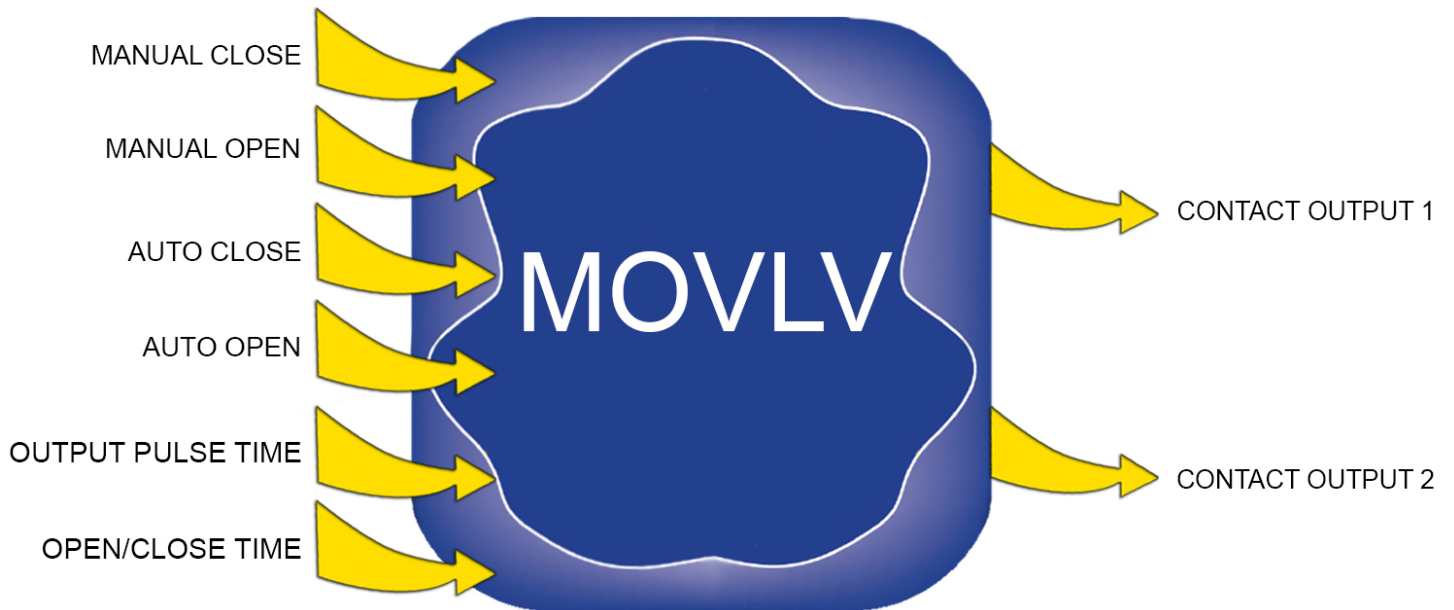

Legal Information

The Schneider Electric brand and any trademarks of Schneider Electric SE and its subsidiaries referred to in this guide are the property of Schneider Electric SE or its subsidiaries. All other brands may be trademarks of their respective owners.

This guide and its content are protected under applicable copyright laws and furnished for informational use only. No part of this guide may be reproduced or transmitted in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), for any purpose, without the prior written permission of Schneider Electric.

Schneider Electric does not grant any right or license for commercial use of the guide or its content, except for a non-exclusive and personal license to consult it on an "as is" basis. Schneider Electric products and equipment should be installed, operated, serviced, and maintained only by qualified personnel.

As standards, specifications, and designs change from time to time, information contained in this guide may be subject to change without notice.

To the extent permitted by applicable law, no responsibility or liability is assumed by Schneider Electric and its subsidiaries for any errors or omissions in the informational content of this material or consequences arising out of or resulting from the use of the information contained herein.

Overview

The MOVLV block provides control of a 3-wire motor operated control valve. The 3-wire configuration provides two pulsed outputs.

As a motor-operated valve controller, the block supports Auto/Manual, Open, Close, and Stop capability. The user defines the output pulse width. Limit switch feedback inputs can be used with the timeout alarm option when the block is used for Open/Close valve control. When the timeout alarm option is enabled, alarming occurs when the requested Open/Close position of the valve does not match the sensed limit position within the specified Open/Close time interval. The block may also be used for valve positioning, but the timeout alarm option should be disabled. A disable mode inhibits MOVLV block operation to allow local control of field equipment.


The block outputs, contact outputs 1 and 2, are mapped to the physical Fieldbus Module points by specifying the Letterbug identification and physical point numbers of the Fieldbus Module. Both outputs must reside in the same Fieldbus Module. The Fieldbus Module has either sustained or momentary outputs. For motor control applications, sustained Fieldbus Module outputs are recommended.

Standard Features

- Manual/Auto control
- Close and Stop valve capability
- User-specifiable pulse output time widths
- Open-loop indication to upstream blocks
- Disable input to enable/disable block actions – can be used as a permissive input when driven by a local field contact for maintenance or local control functions

Optional Feature

- Timeout alarming of valve limit positions

 **WARNING:** This product can expose you to chemicals including lead and lead compounds, which are known to the State of California to cause cancer and birth defects or other reproductive harm. For more information, go to www.p65warnings.ca.gov/.

Schneider Electric Systems USA, Inc.
38 Neponset Avenue
Foxborough, Massachusetts 02035–2037
United States of America

Global Customer Support: <https://pasupport.schneider-electric.com>

As standards, specifications, and design change from time to time, please ask for confirmation of the information given in this publication.

© 2014–2019 Schneider Electric. All rights reserved.

PSS 41S-3MOVLV, Rev A