




Foxboro™ DCS

On-Off Valve (VLV) Block

PSS 41S-3VLV

Product Specification

May 2019

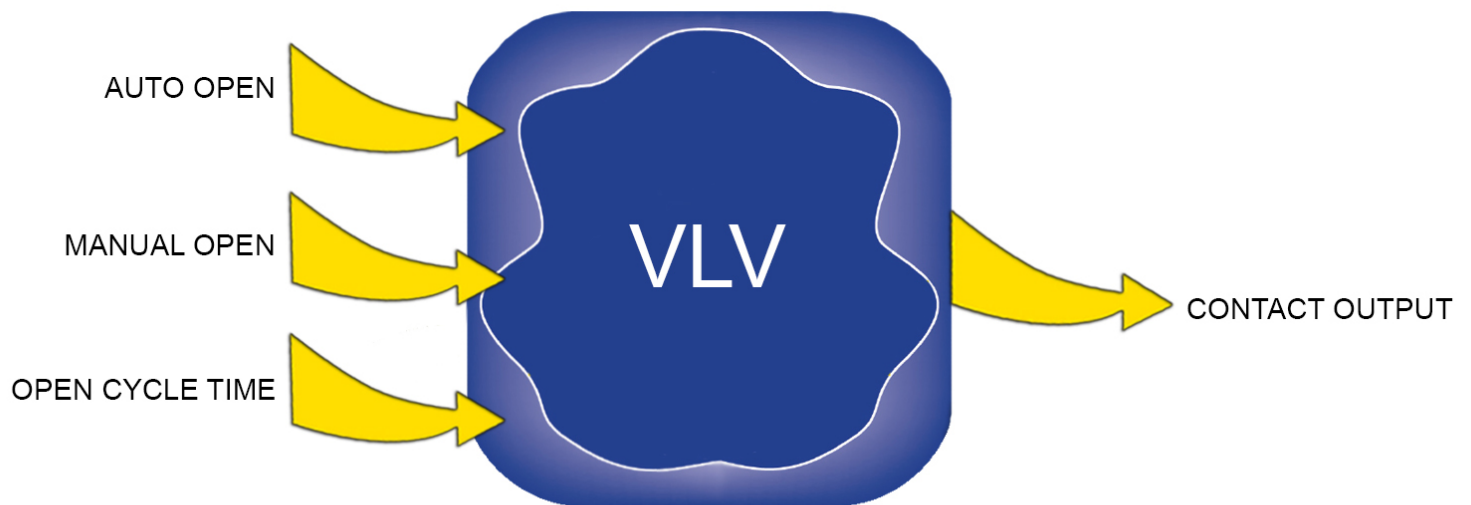

Legal Information

The Schneider Electric brand and any trademarks of Schneider Electric SE and its subsidiaries referred to in this guide are the property of Schneider Electric SE or its subsidiaries. All other brands may be trademarks of their respective owners.

This guide and its content are protected under applicable copyright laws and furnished for informational use only. No part of this guide may be reproduced or transmitted in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), for any purpose, without the prior written permission of Schneider Electric.

Schneider Electric does not grant any right or license for commercial use of the guide or its content, except for a non-exclusive and personal license to consult it on an "as is" basis. Schneider Electric products and equipment should be installed, operated, serviced, and maintained only by qualified personnel.

As standards, specifications, and designs change from time to time, information contained in this guide may be subject to change without notice.

To the extent permitted by applicable law, no responsibility or liability is assumed by Schneider Electric and its subsidiaries for any errors or omissions in the informational content of this material or consequences arising out of or resulting from the use of the information contained herein.

Overview

The VLV block provides open/close control of motor or air-operated valves. The block supports a 2-wire configuration using a single sustained output.

As an Open/Close valve controller, the block supports Auto-Open and Manual-Open capability as determined by the Manual/Auto state. In Manual, operator Open/Close requests are honored. In Auto, Open/Close requests from other blocks or tasks are honored.

Valve status feedback input is used with a timeout alarm parameter. Valve status input originates from a CIN or MCIN block. When the timeout parameter is enabled, alarming occurs when requested state of the valve does not match the sensed state within a user-specified time interval. Valve position is monitored by limit switches at the fully-open and fully-closed positions. When the valve reaches either extreme, the block generates an alarm for monitoring purposes. A disable mode inhibits VLV block operation to allow local control of field equipment.


The block output, contact output, is optionally mapped to the physical Fieldbus Module point by specifying the Letterbug identification and physical point number of the Fieldbus Module. The Fieldbus Module has sustained or momentary outputs. For valve control applications, a sustained Fieldbus Module output is recommended.

Standard Features

- Manual/Auto control
- State alarming
- Valve limit switch monitoring
- Disable input to enable/disable block actions – can be used as a permissive input when driven by a local field contact for maintenance or local control functions
- Open loop detection

Optional Feature

- Inversion of limit switch inputs provided by CIN or MCIN blocks

 **WARNING:** This product can expose you to chemicals including lead and lead compounds, which are known to the State of California to cause cancer and birth defects or other reproductive harm. For more information, go to www.p65warnings.ca.gov/.

Schneider Electric Systems USA, Inc.
38 Neponset Avenue
Foxborough, Massachusetts 02035–2037
United States of America

Global Customer Support: <https://pasupport.schneider-electric.com>

As standards, specifications, and design change from time to time, please ask for confirmation of the information given in this publication.

© 2014–2019 Schneider Electric. All rights reserved.

PSS 41S-3VLV, Rev A